

Terminator G (2-1/2" - 12")

IMPORTANT

Please read the **Connection Guidelines** prior to installing these components. Failure to follow these instructions may damage the component and/or void the warranty.


CAUTION

This valve must not be lifted by holding the hand wheel.



Installation:


1. The Terminator G is a unidirectional balancing device. The arrow on the valve body must be in the direction of flow.
2. For horizontal installations, the valve should be installed with the readout port on or above the horizontal centerline. DO NOT install valve with the readout port facing down. Debris from the line can clog the port during the readout process. This can result in leaks.

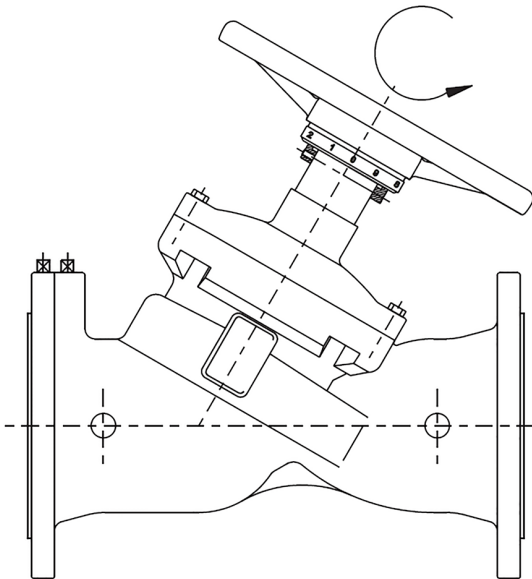

upstream, and 2 1/2 straight pipe diameters are required downstream of the Terminator G to ensure specified accuracy. If the Terminator G is located on the outlet of a pump. There must be a minimum of 10 pipe diameter between the pump outlet and the valve inlet.

To Balance:

1. Take a reading using a differential pressure gauge calibrated in inches of water. Connect the "high" side line to the upstream port, and the "low" side line to the downstream port.
2. The desired differential pressure can be found by referencing the location tag attached to the valve or by referring to the Terminator G pressure drop chart which is part of the spec sheet.
3. Throttle the valve until the desired differential pressure is indicated on the gauge. Using a hex wrench, loosening the set screws on the limitation cap. Slide the cap up until it sits snug against the plastic indicator. Tighten the set screws.
4. Record the hand wheel setting on balancing location tag attached to the valve. This will allow the valve to be properly reset in the event the memory stop setting is lost.

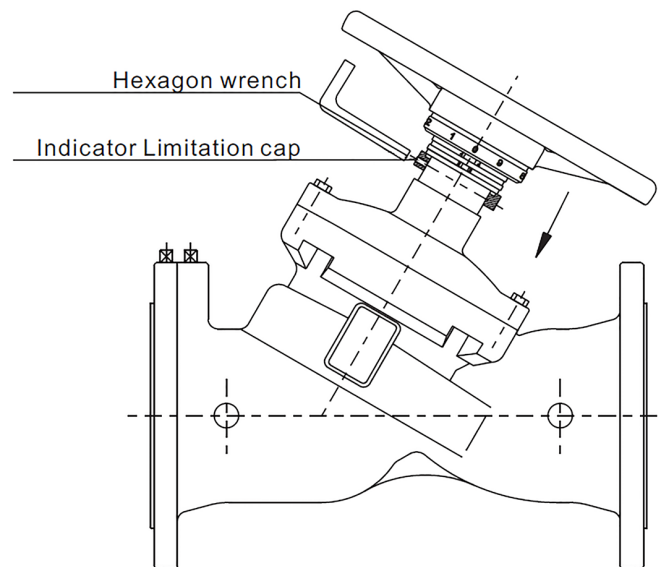


Pressure Drop Chart



- CV of Valves**
- 2-1/2" : 120.22
 - 3" : 134.10
 - 4" : 246.23
 - 6" : 550.26
 - 8" : 887.81
 - 10" : 1332.87
 - 12" : 2014.91

Metering Signal

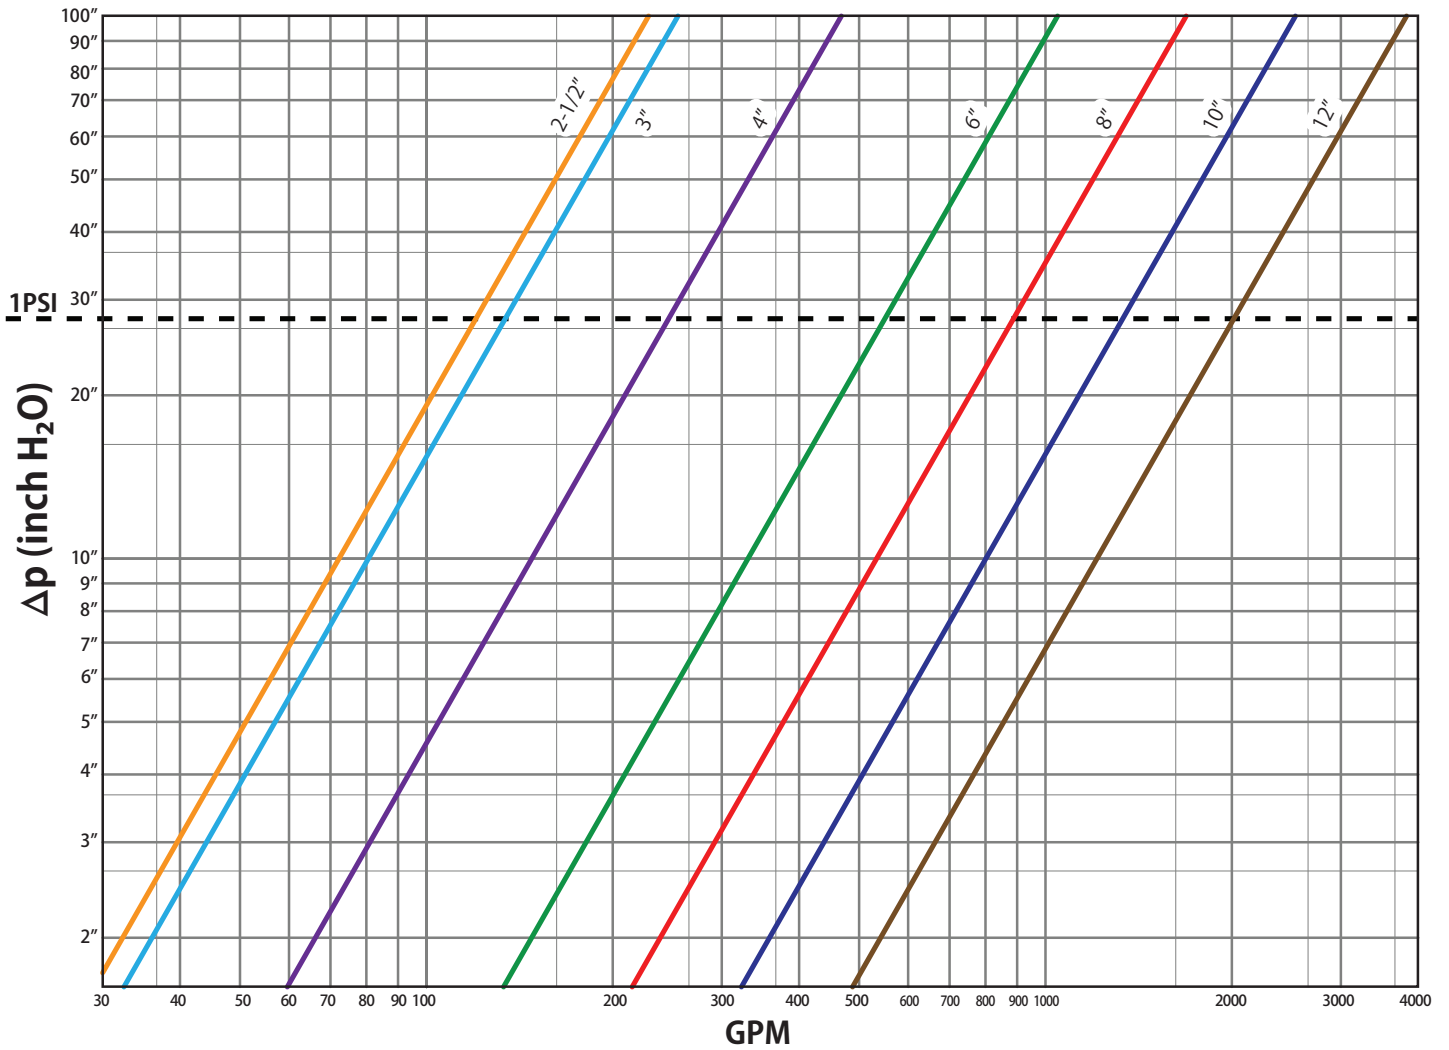

General Information

For proper operation, make sure that the system in which the valve is installed is free of debris, and that the water is devoid of entrained air. Air and debris will cause the balancing valves supplied by **Jomar Valve** to function improperly. A strainer with a minimum 20 mesh screen is recommended upstream of all balancing valves to prevent clogging. High point and inline air vents are also recommended to ensure all entrained air is removed.

On chilled water systems, the test ports may seep after a reading is taken. Re-install the port cap and wait approximately one minute. Check the port. If seepage is still present, re-insert probe and remove slowly to allow port to seal.

Performance Guarantee:

Jomar Valve guarantees to the original purchaser that the equipment of its manufacture will perform at the rated capacity as stated only when (1) properly installed, connected, started, operated and maintained in accordance with Company instruction(s) and/or information guide(s), as revised from time to time, (2) used for the applications specified and (3) used in the environments as specified or as limited. If equipment is part of a greater system, the Company accepts responsibility only for the equipment manufactured by it.

Water Treatment

Introduction of chemical cleaners, stabilizers and solvents into the systems may cause damage to the seats, seals, liners and gaskets or cause stress corrosion cracks in the product. Consult a water treatment specialist whenever introducing chemicals. It is important that you analyze all aspects of your systems components and the systems application with any introductions of chemicals into a system. It is solely the responsibility of the purchaser, contractor or engineer to review the material specification sheets for compatibility of these products. The documentation for the products described herein are subject to change at any time without notice. To obtain a copy of the current product specification sheets, **please visit www.jomarvalve.com or contact us at (586) 268-1220 or csr@jomar.com.**

Connection Guidelines

Flanged Ends

When installing flanged joints, ensure that the flanges are properly aligned prior to installation. Be sure to evaluate that no side loading is occurring. When tightening flanges, do so in a star type pattern to properly level out the joint. All bolting materials and torques must meet applicable codes. Appropriate gasketing material must be used when installing flange-mounted valves

Factory Assembled Threaded Connections

All threaded bosses found on our components will contain either a PT port, accessory, accessory extension, or plug. All of the connections are made using Teflon tape or Loctite, and are factory tested up to 120 PSI to ensure a leak free joint. The removal or modification of any of these connections voids the warranty of the joint, as well as the warranty of the component. Contact us prior to modifying any factory assembled connections.